

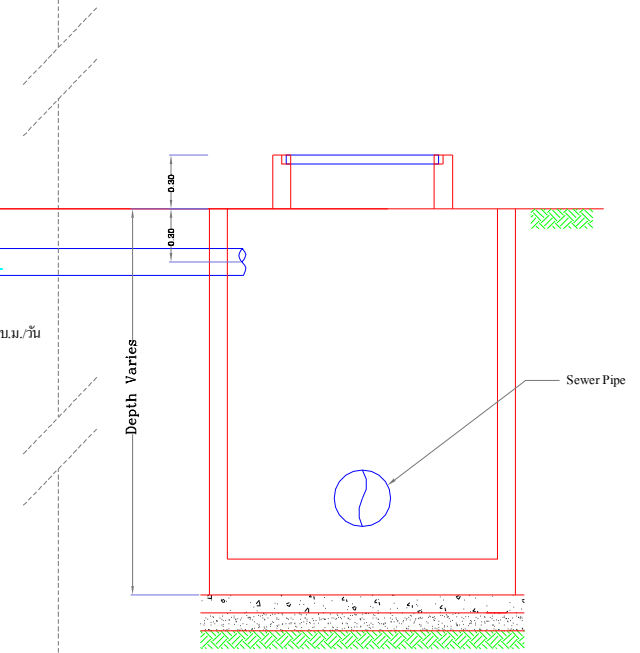


Factory Area

IEAT Area

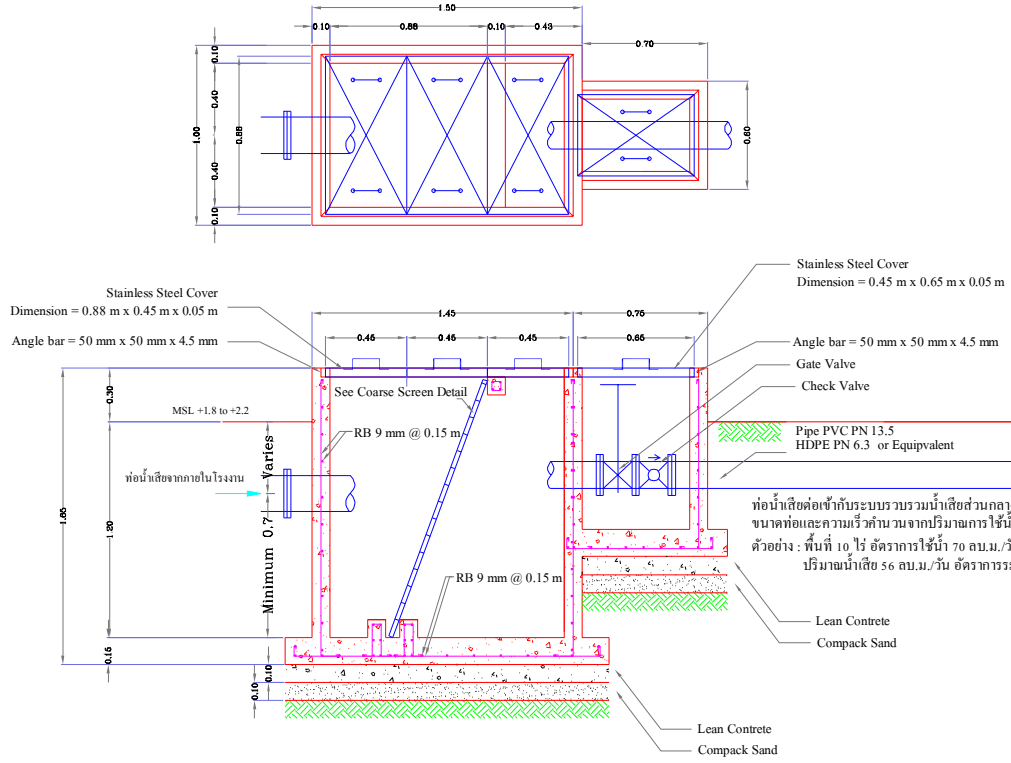

Sampling Pits and Box Valve ขนาดเปลี่ยนแปลงตามปริมาณน้ำเสีย

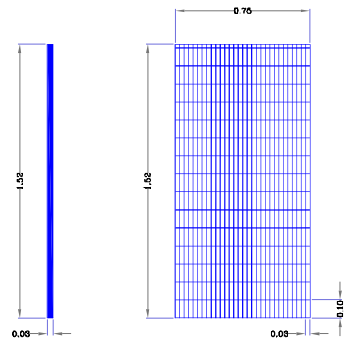

Coarse Screen (Hot dip Galvanize)
Dimension = 1.52 m x 0.75 m
Inlet Strait = 0.100 m x 0.025 m
Material = Flat Bar Steel : Width 3.2 mm x Thickness 4

Coarse Detail

AMATA WATER CO.,LTD.			
Project : Sampling Pit			
Dwg.Tle.: Sampling Pit Detail			
Designed by	Approved by	Date	Dwg.No.
		Feb.12,2015	Sampling Pit